



Hammond
Power Solutions

GUELPH, ONT. BARABOO, WI COMPTON, CA MONTERREY, MX




LR 3902
DRY TYPE
TRANSFORMER
77US
E112313

LISTED

THREE PHASE DRY TYPE TRANSFORMER
TRANSFORMATEUR SEC TRIPHASE

HV/HT	480V			Cust. Ref. Réf. du client	
BIL	-			Serial No. No. de série	
TERM. BORNES	H1 H2 H3			Part No. No. de pièce	MK015KB
	VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE	kVA
	480	18.0	100	1	15
	456	19.0	95	2	TYPE
	432	20.0	90	3	K
	208Y/120V			Cooling Refroidissement	ANN
LV/BT	-			Temp. Rise Echauffement	150 °C
BIL	-			Temp. Class Classe de Temp.	220 °C
TERM. BORNES	X0 X1 X2 X3			Frequency Fréquence	60 Hz
				Impédance % @ 170 °C	4.8
				Encl. Type Type de boîtier	3R
				Wt lbs Poids	165
				Winding Enroulement	AL

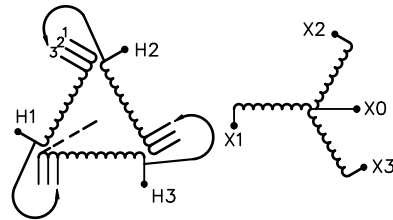

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

47003002b



Hammond Power
Solutions Inc.


TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

2	20/12/09	CS	DESIGN UPDATED	DES: IKLING
1	14/03/17	RM	HCN: 27751	DATE: 99/08/24
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 2

EDBMK015KB

2.1 cshoh 2020/12/10 08:38

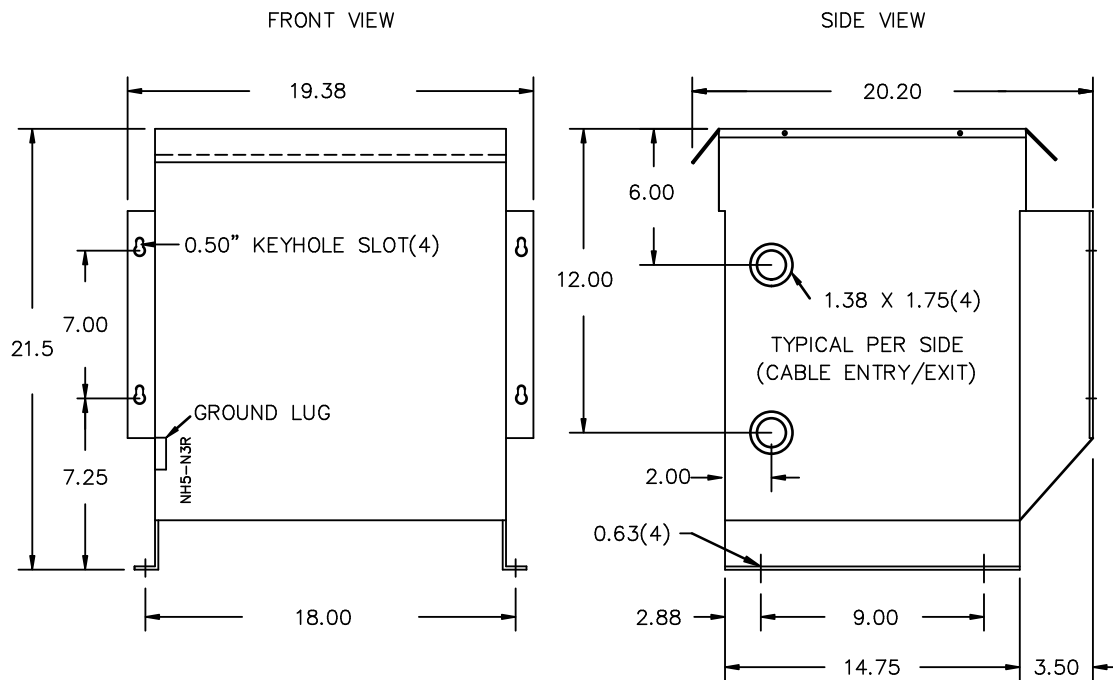

All Dimensions in inches

ENCLOSURE COLOR : ANSI-61 GREY PAINT OUTDOOR.

HV TERMINAL DETAIL

LV TERMINAL DETAIL

SUITABLE FOR #14-4 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT BOTTOM FRONT
- LV TERMINATED AT BOTTOM FRONT



TITLE: 3PH DISTRIBUTION TRANSFORMER

2	20/12/09	CS	DESIGN UPDATED	DES: IKLING
1	14/03/17	RM	HCN: 27751	DATE: 99/08/24
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 2

EDBMK015KB

2.1 cshoh 2020/12/10 08:38